
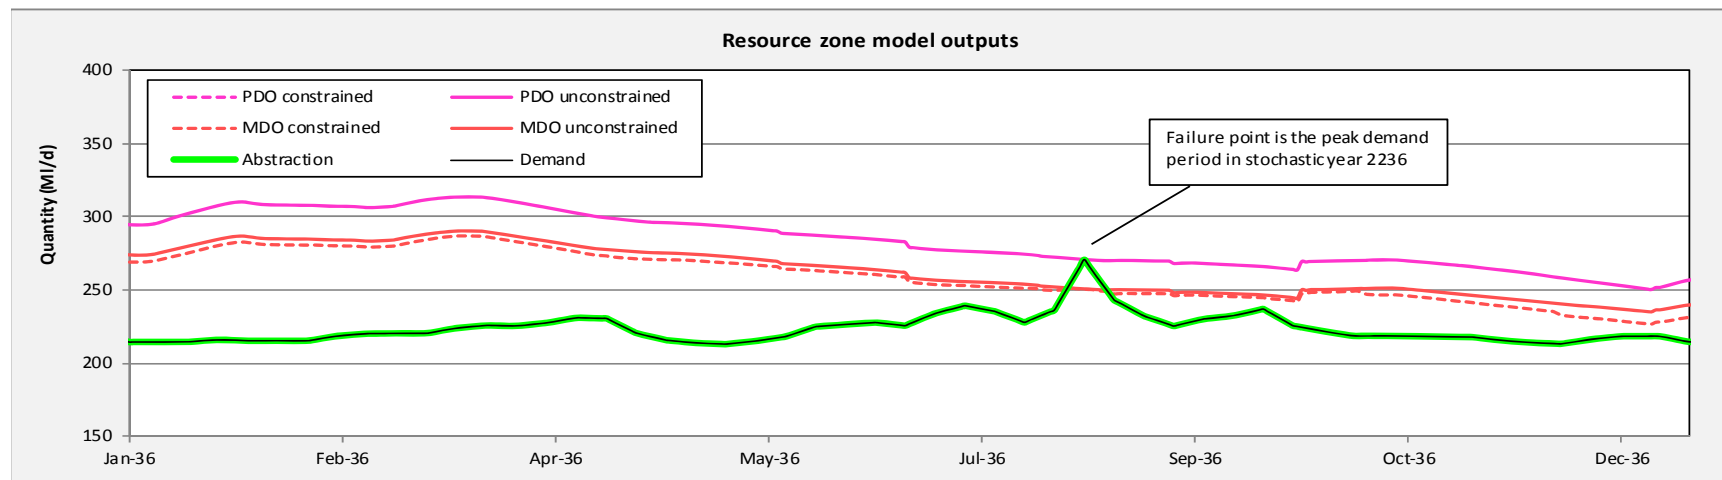




1 in 40 year DO (stochastic) with restricted demand profile (TUBs)

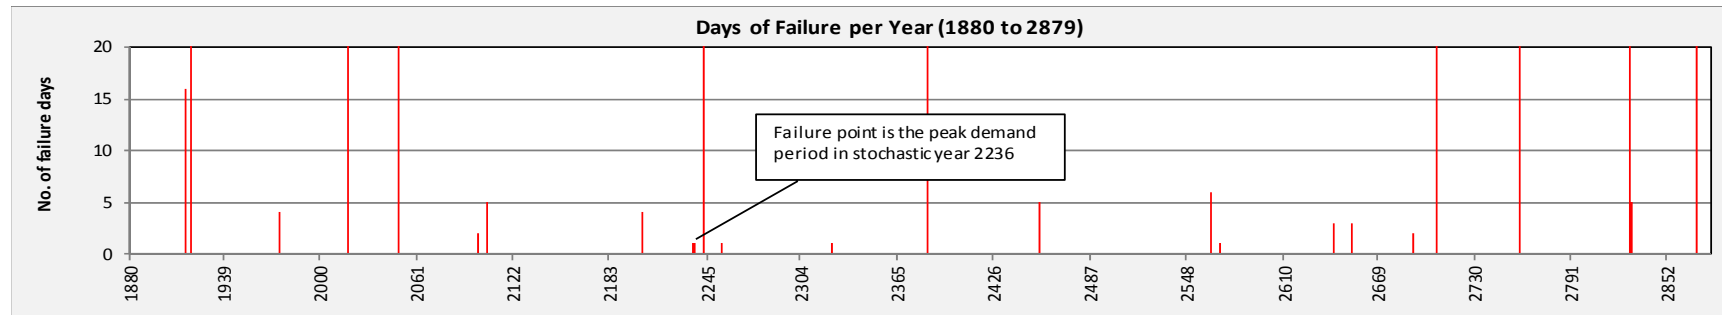

Water Resource Zone results



Run type	Stochastic
Demand profile	2
Demand description	TUBs
ADO	224
Wettest Dry Year	2236
PDO	270
MDO	237
MDO Date	23/12/2336
PDO Date	13/08/2336

1 in 80 year DO (stochastic) with restricted demand profile (ODOs)

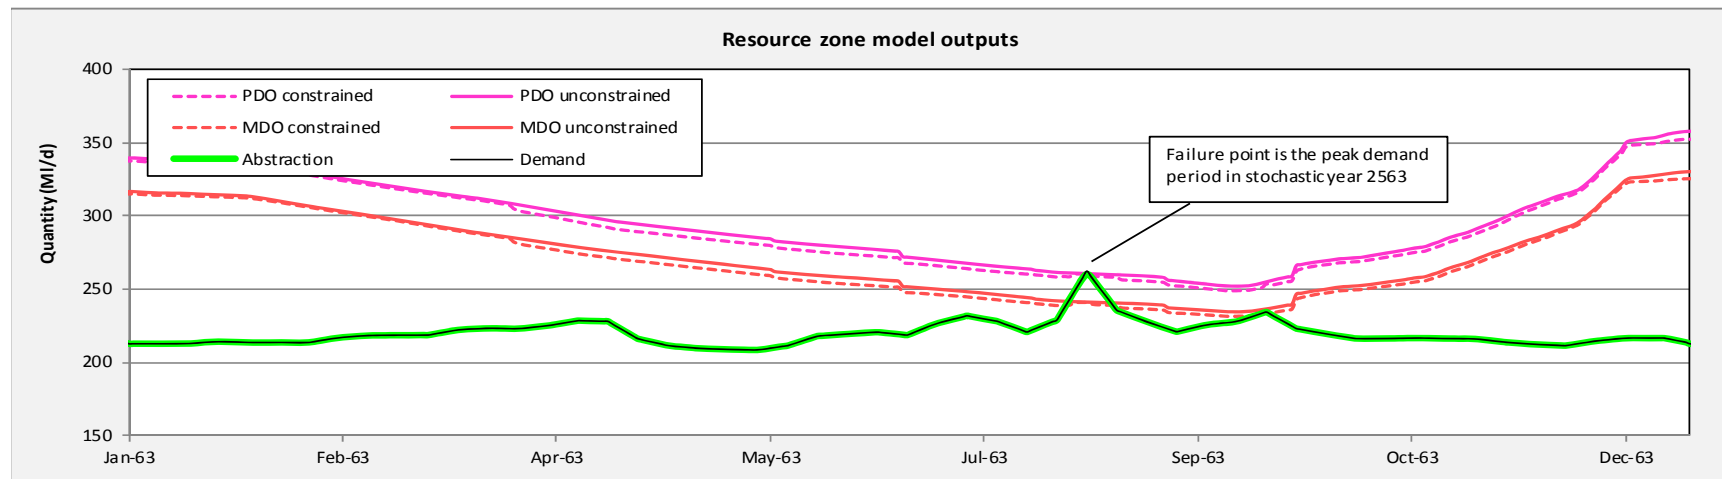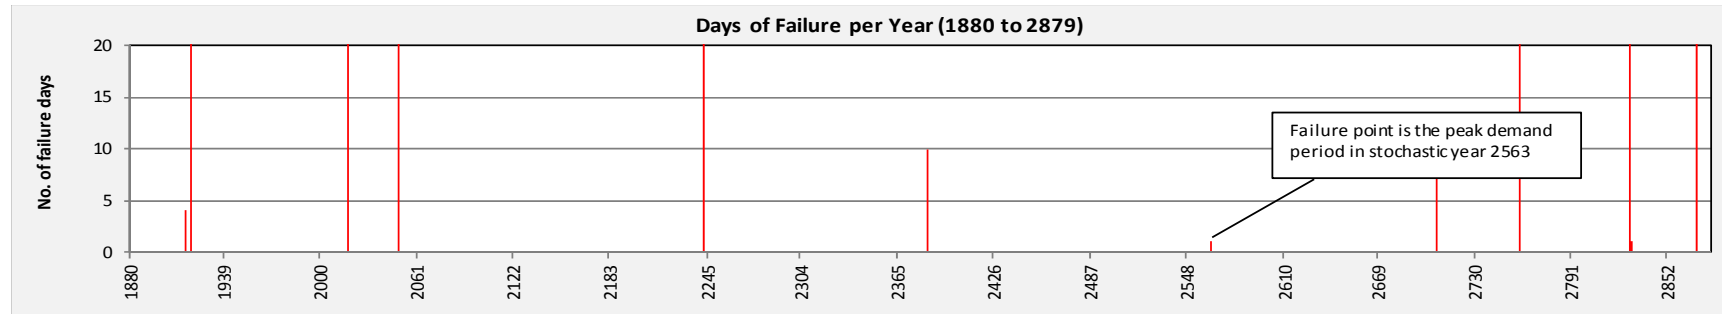



Water Resource Zone results	
Run type	Stochastic
Demand profile	3
Demand description	ODOs
ADO	220
Wettest Dry Year	2563
PDO	263
MDO	233
MDO Date	15/09/2663
PDO Date	13/08/2663

1 in 125 year DO (stochastic) with restricted demand profile (ODOs)

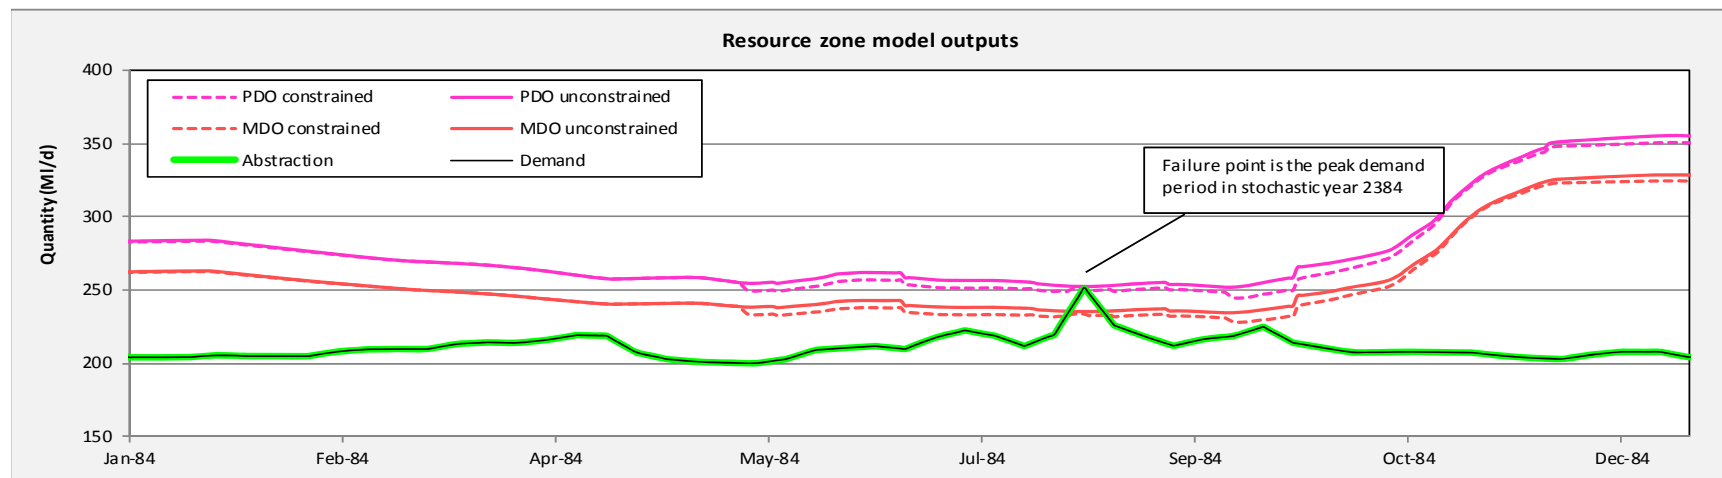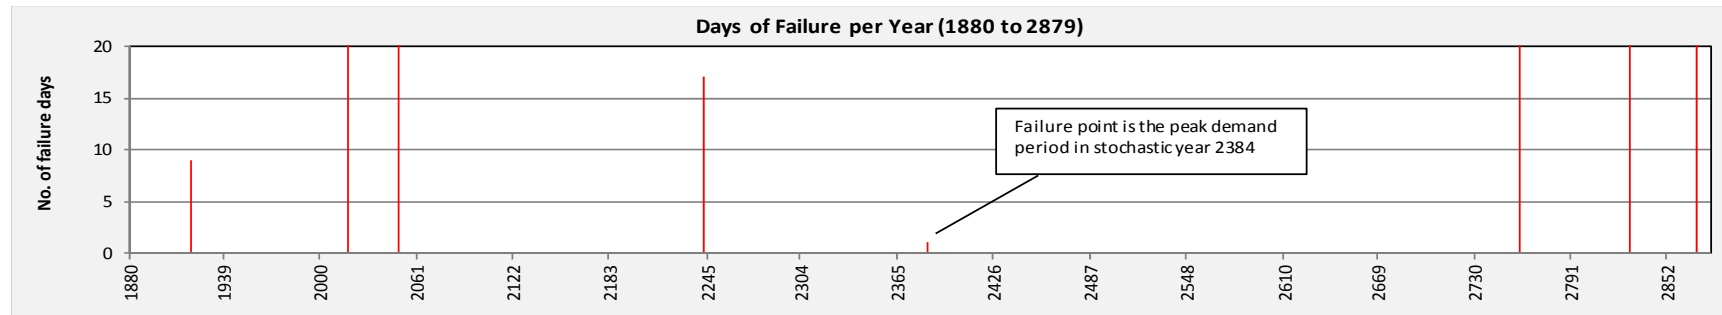

Water Resource Zone results	
Run type	Stochastic
Demand profile	3
Demand description	ODOs
ADO	211
Wettest Dry Year	2384
PDO	252
MDO	235
MDO Date	19/09/2484
PDO Date	13/08/2484



1 in 200 year DO (stochastic) with restricted demand profile (ODOs)

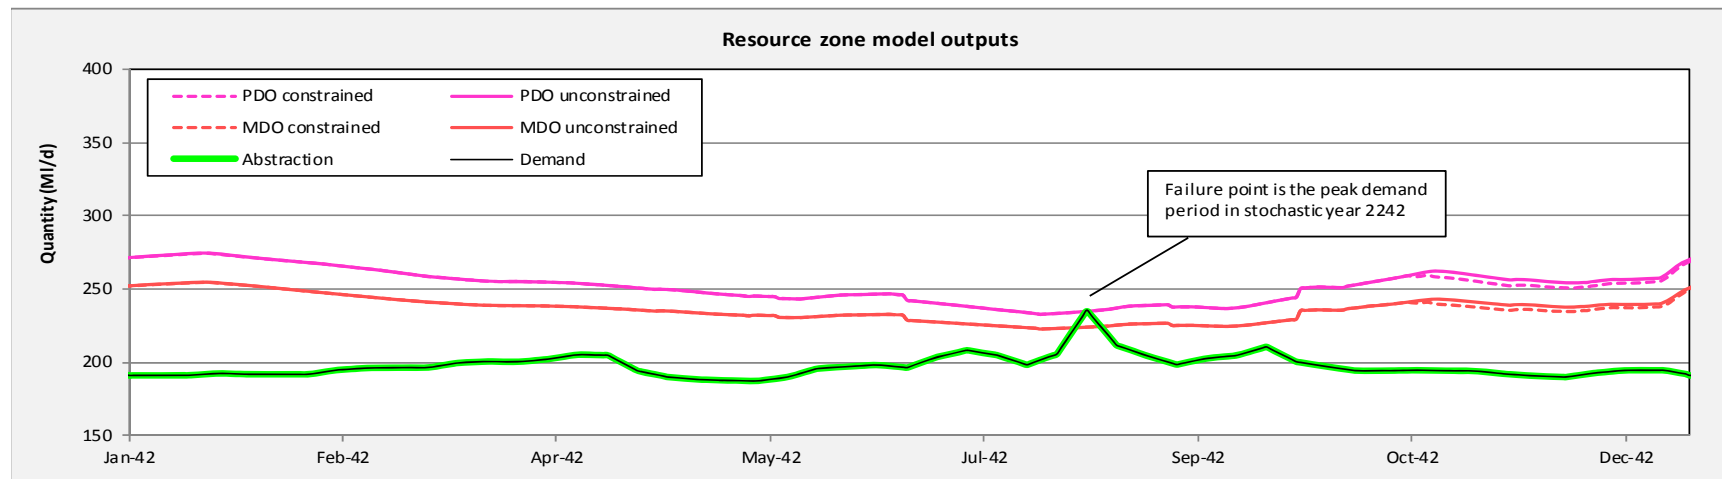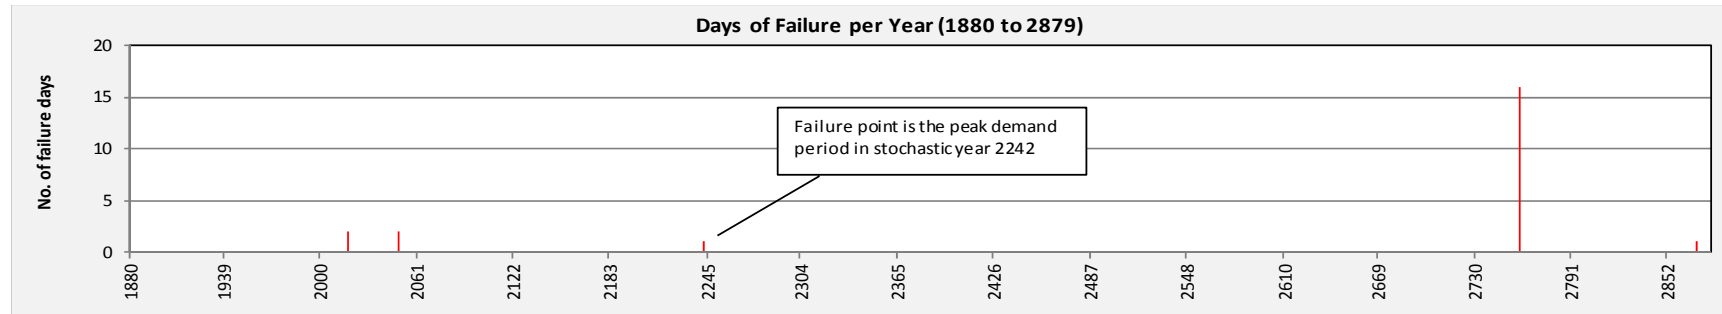

Water Resource Zone results

Run type	Stochastic
Demand profile	3
Demand description	ODOs
ADO	197
Wettest Dry Year	2242
PDO	236
MDO	222
MDO Date	02/08/2342
PDO Date	13/08/2342

1 in 20 year DO (stochastic) with restricted demand profile (TUBs)

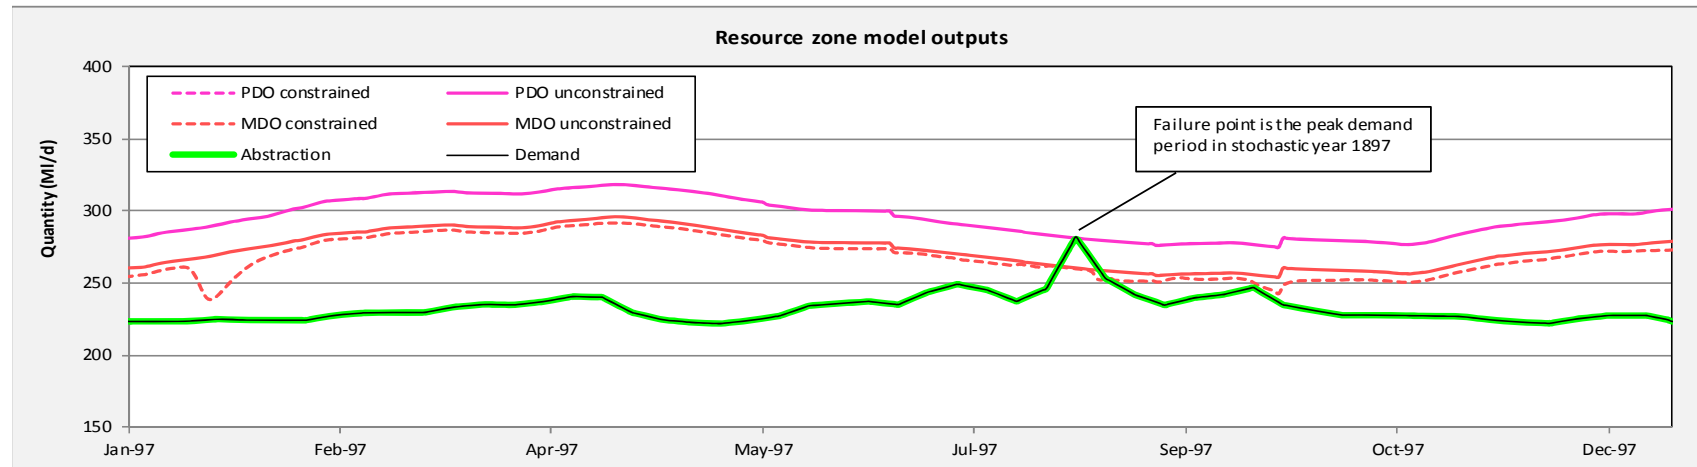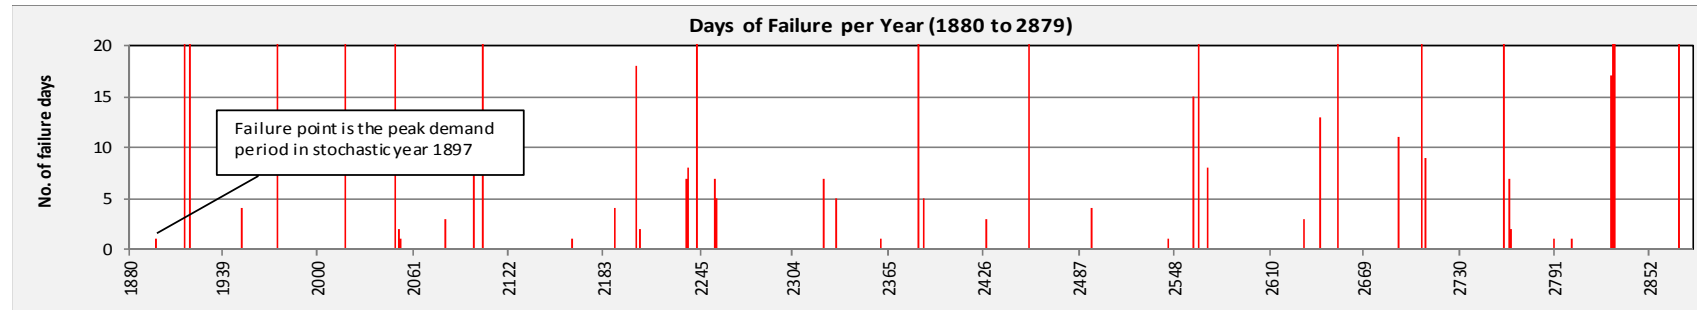

Water Resource Zone results

Run type	Stochastic
Demand profile	2
Demand description	TUBs
ADO	233
Wettest Dry Year	1897
PDO	280
MDO	252
MDO Date	30/09/1997
PDO Date	13/08/1997